



LV HRC ISOLATING LINK, SIZE 00 WITH INSULATED GRIPPING LUG

Similar to image

Technical data:

| | | |
|---------------------------------|---|----------|
| Installation size of fuse-link | | LV HRC00 |
| Operating current / rated value | A | 160 |

Certificates/approvals:

| General Product Approval | Declaration of Conformity | Test Certificates | |
|---------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------|----------------------------------------------------|
|  GOST |  EG-Konf. | Special Test Certificate | Type Test Certificates/Test Report |

Further information:

Information- and Downloadcenter (Catalogs, Brochures,...)

<http://www.siemens.com/lowvoltage/catalogs>

Industry Mall (Online ordering system)

<https://eb.automation.siemens.com/mall/en/WW/Catalog/Product/3NG1002>

Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

<http://support.automation.siemens.com/WWW/view/en/3NG1002/all>

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, ...)


http://www.automation.siemens.com/bilddb/cax_en.aspx?mlfb=3NG1002

CAX-Online-Generator

<http://www.siemens.com/cax>

Tender specifications

[Datanorm GAEB81](#) [GAEB83](#) [RTF](#) [TXT](#)

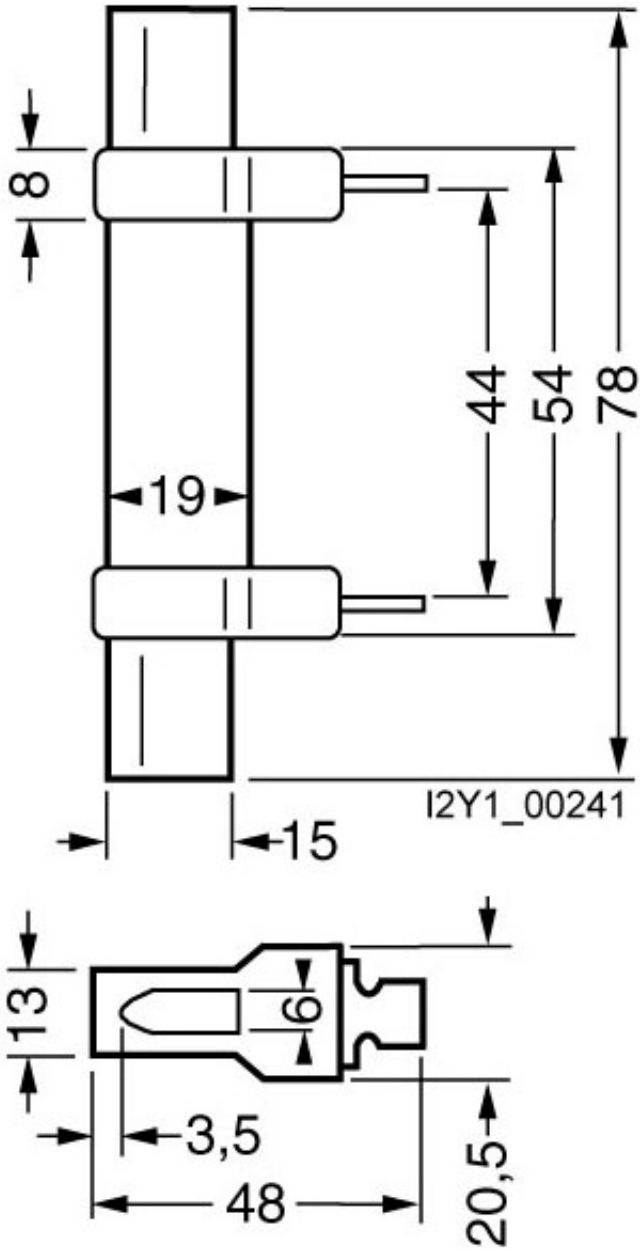

last change:

Jul 7, 2014